


Q	1	12
Q	1	12
Q	1	12

Q	5	4
Q	5	4
Q	5	4

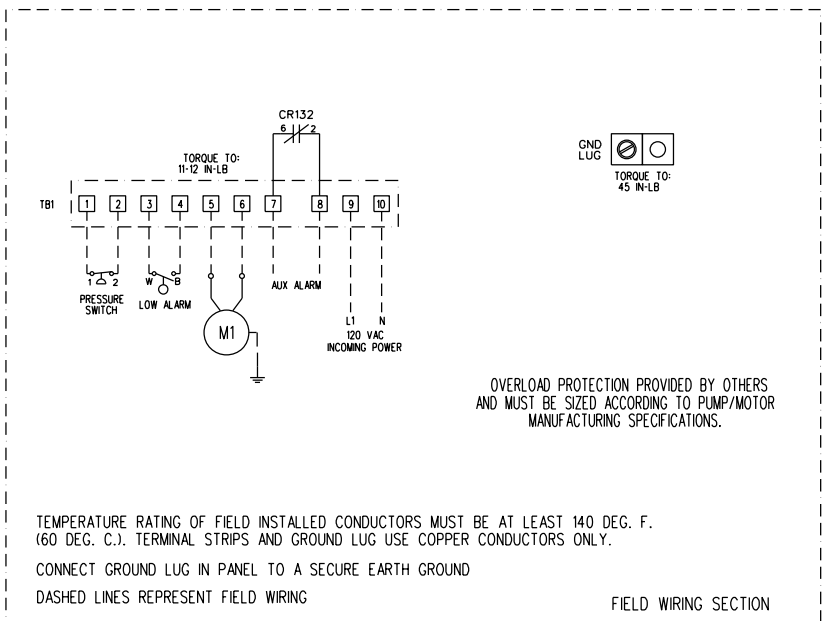

TEMPERATURE RATING OF FIELD INSTALLED CONDUCTORS MUST BE AT LEAST 140 DEG. F. (60 DEG. C.). TERMINAL STRIPS AND GROUND LUG USE COPPER CONDUCTORS ONLY.
CONNECT GROUND LUG IN PANEL TO A SECURE EARTH GROUND
DASHED LINES REPRESENT FIELD WIRING

OVERLOAD PROTECTION PROVIDED BY OTHERS AND MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

FIELD WIRING SECTION

REV. OR. FOR BUSINESS		NOTICE: THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND IT SHALL NOT BE USED OR REPRODUCED OR ITS CONTENTS DISCLOSED IN WHOLE OR IN PART, WITHOUT PRIOR WRITTEN CONSENT.		PROJECT NO. 1031665		QUOTE NO. N/A	REV. A
DRWN BY GDV	DATE 03.30.11	CHKD BY GDV	DATE 03.30.11	APPD BY RMS	DATE 03.30.11	TITLE LIT, FLOB, SCH SPLX GLYCOL	
A	5737	03.11	GDV	DEM NAME FLOFAB	DEM P/N N/A	PAGE 1 of 1	SCALE NONE
REV	ECO NO.	DATE	DRWN	APPD			